

2 μm

Mag = 5.50 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_01.tif



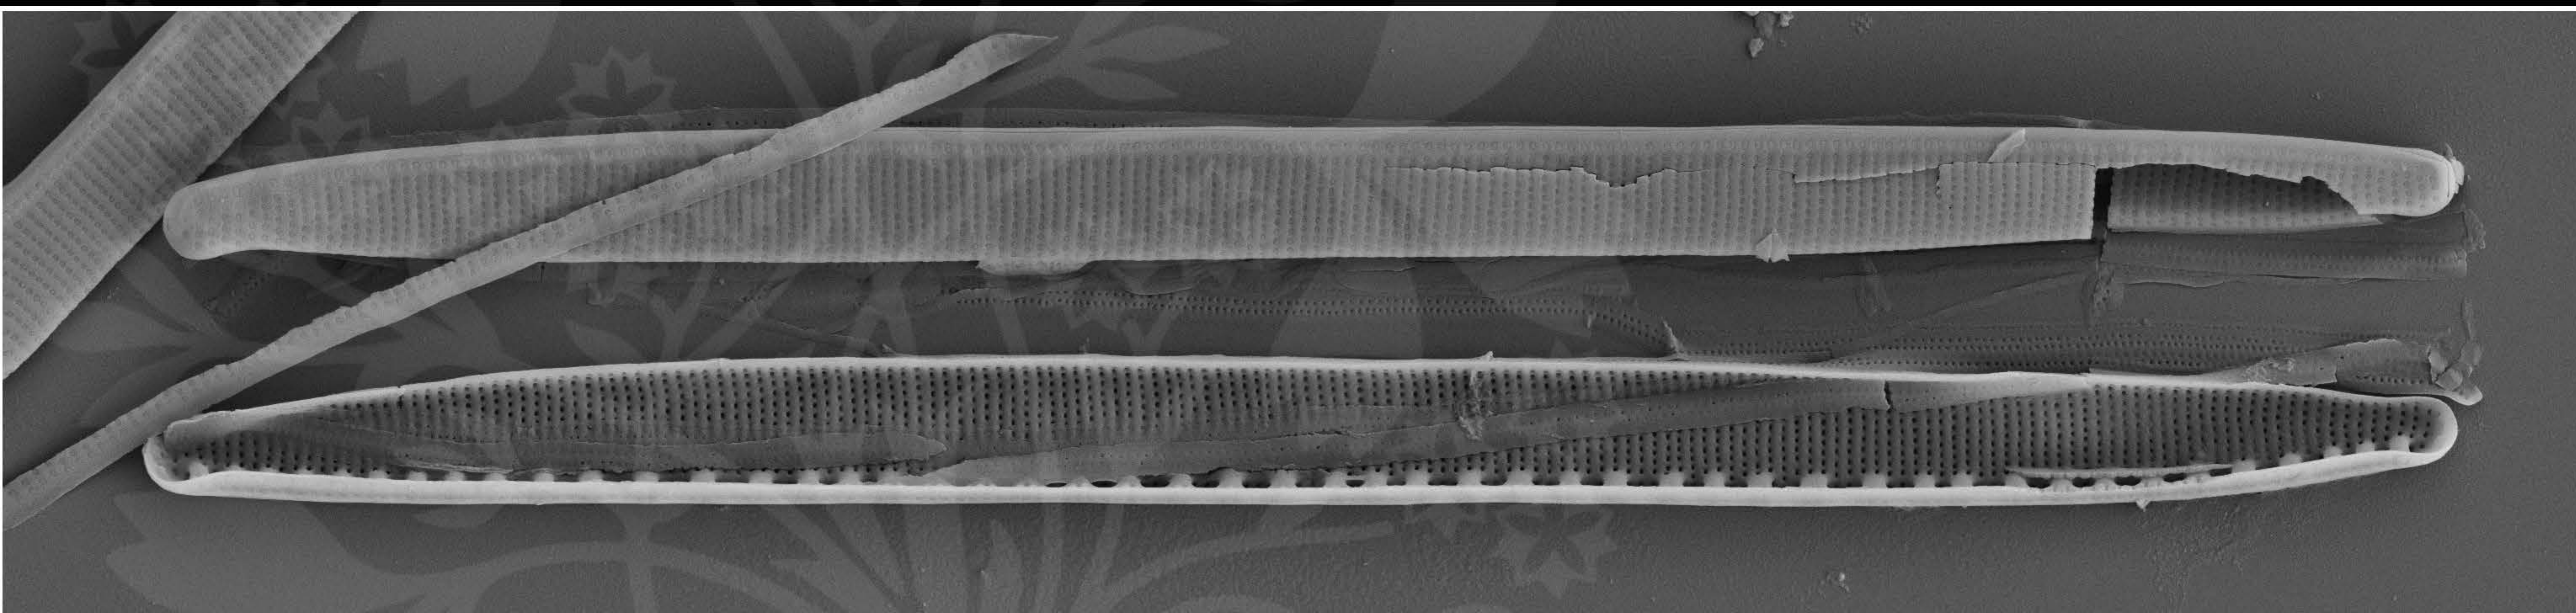

1 μ m

Mag = 5.50 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_02.tif



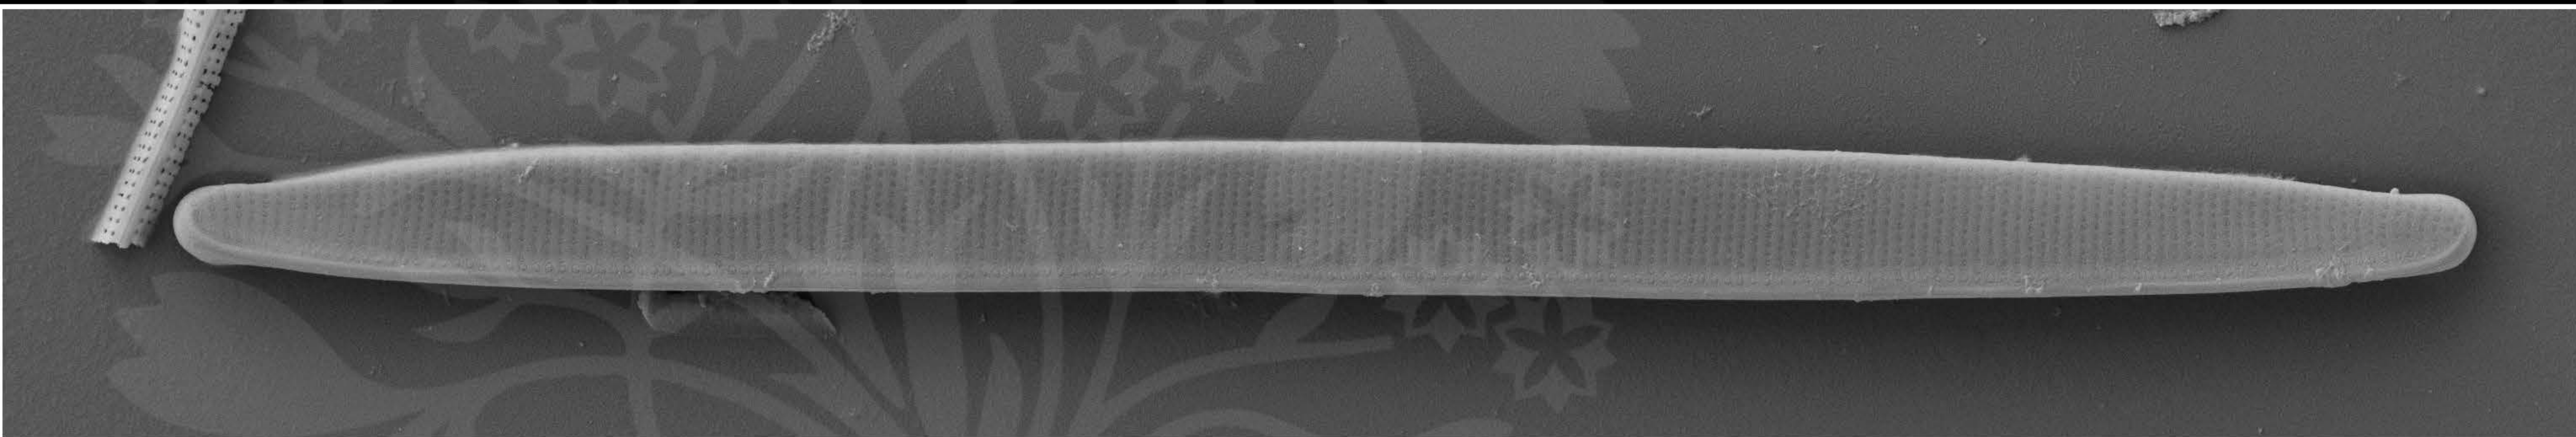

1 μ m
└─┘

Mag = 5.50 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_03.tif



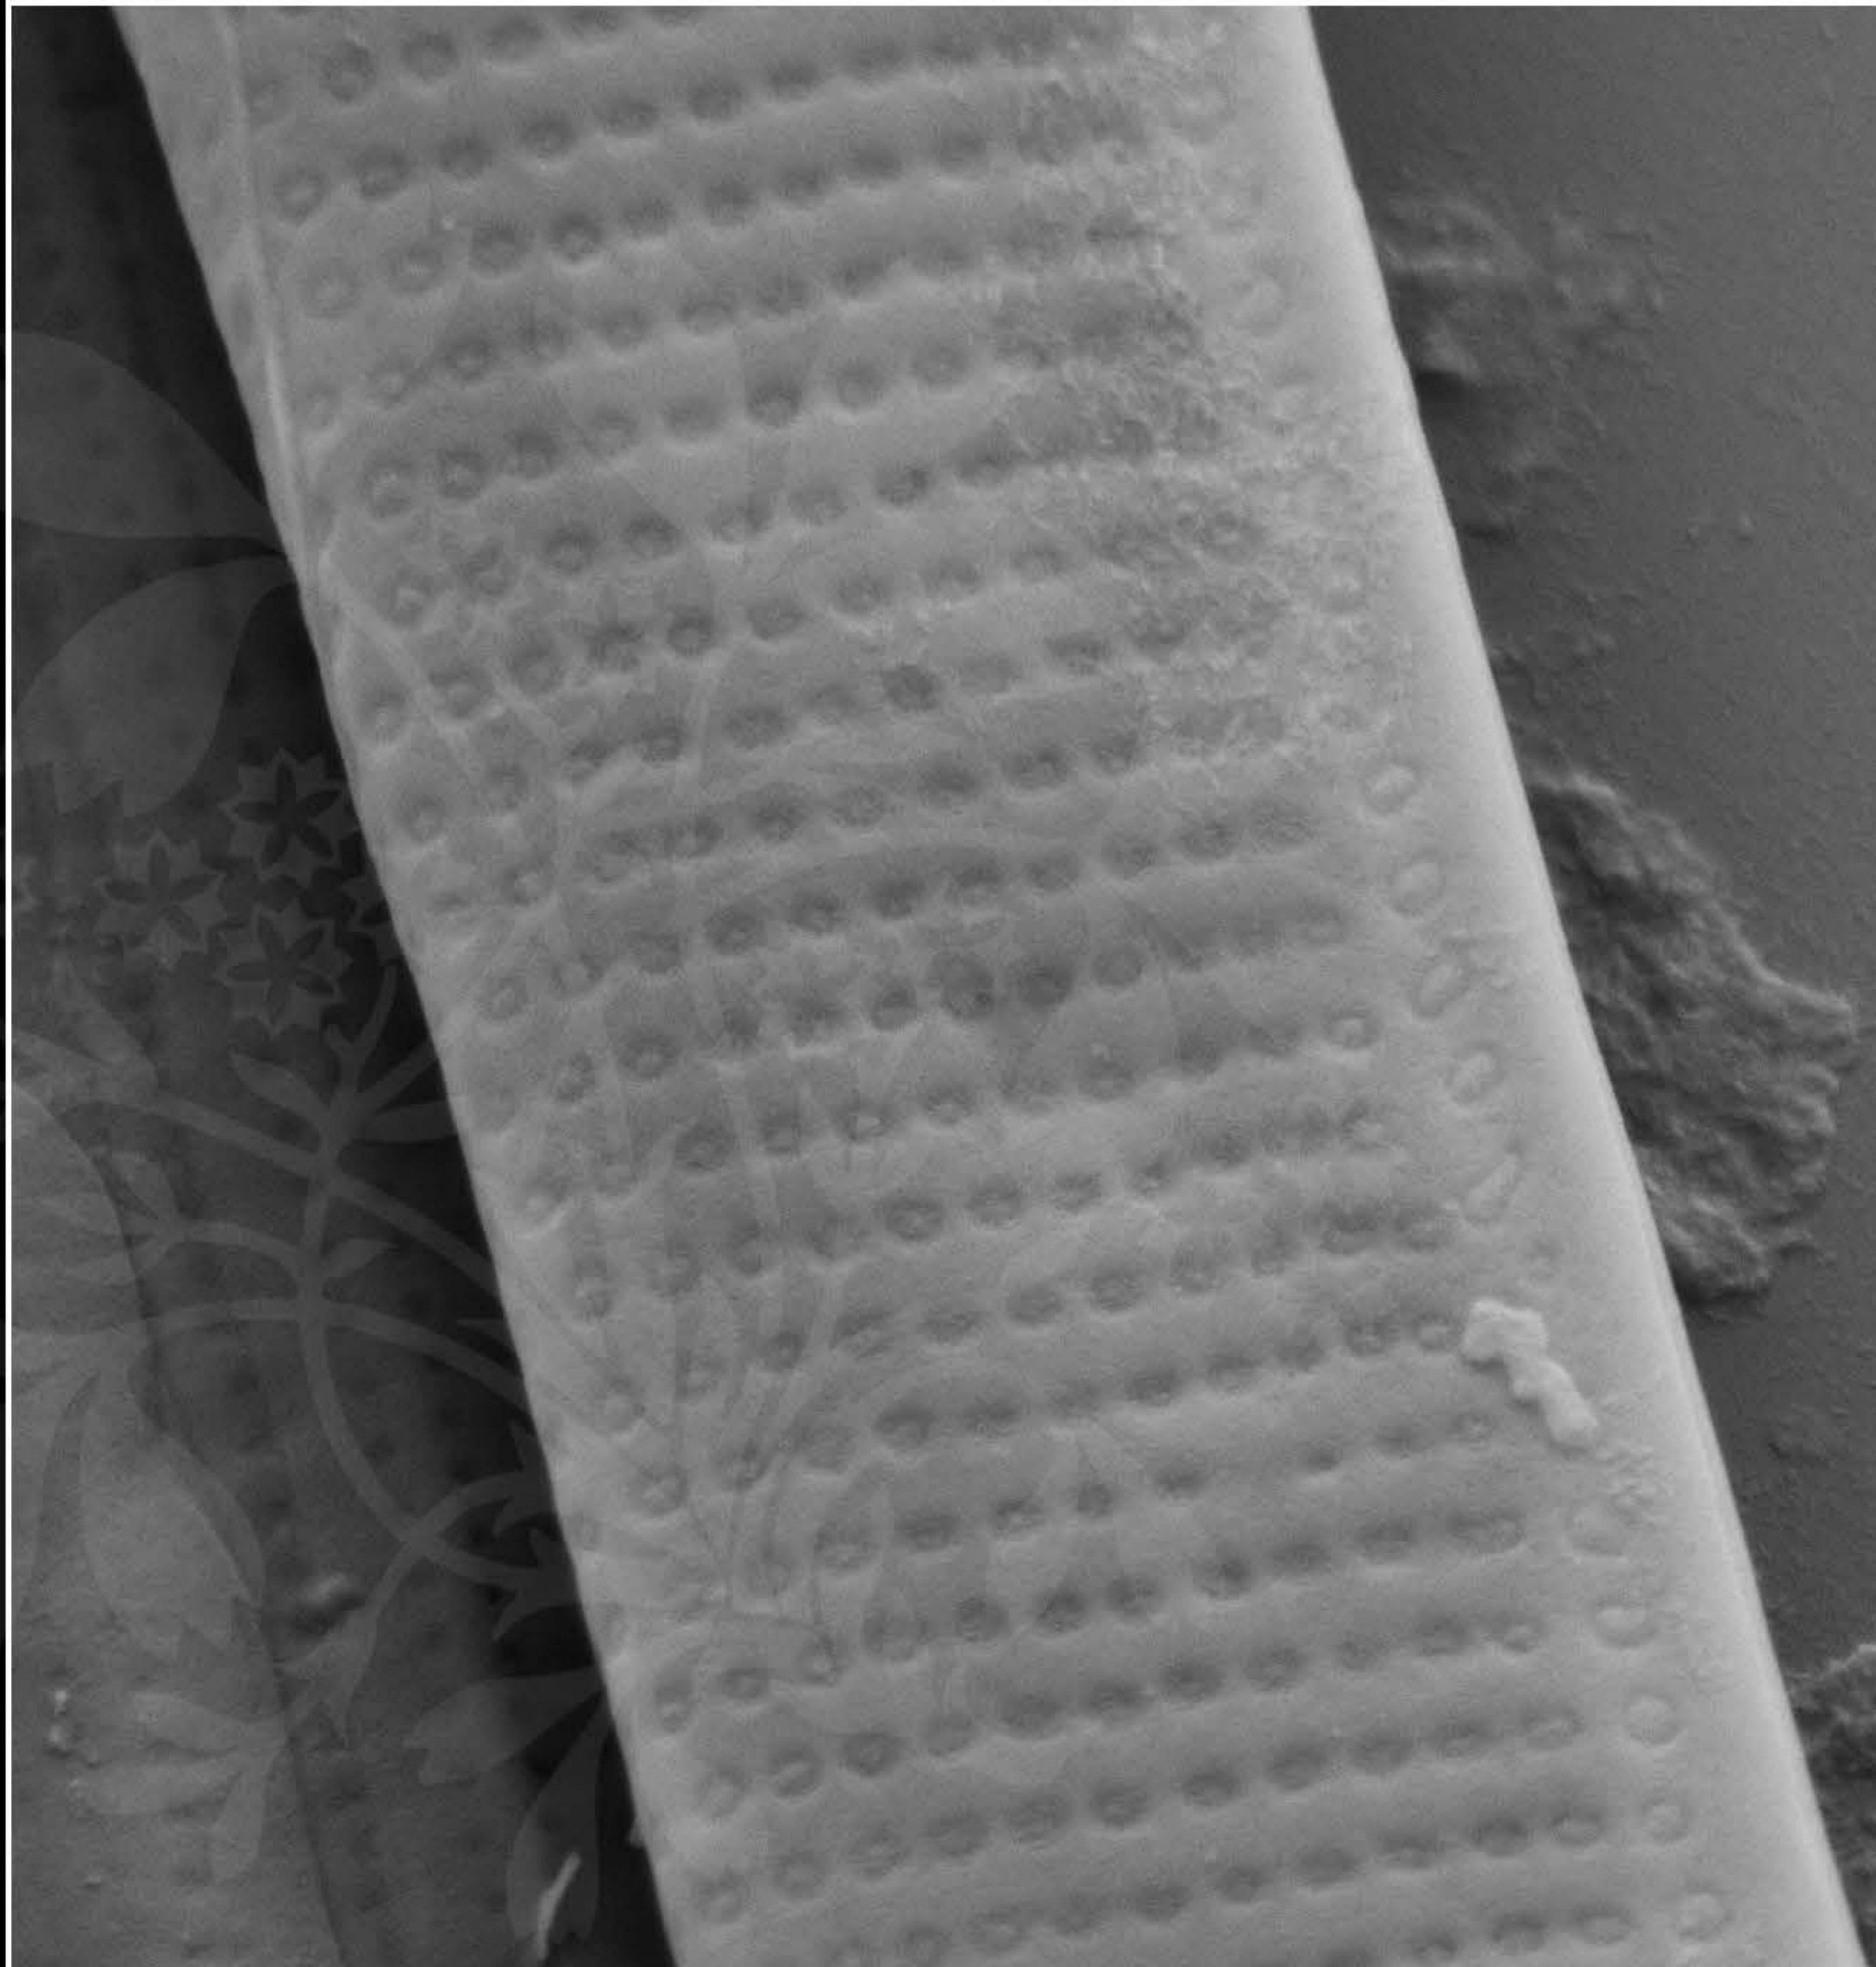

200 nm
└───┘

Mag = 40.00 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_04.tif



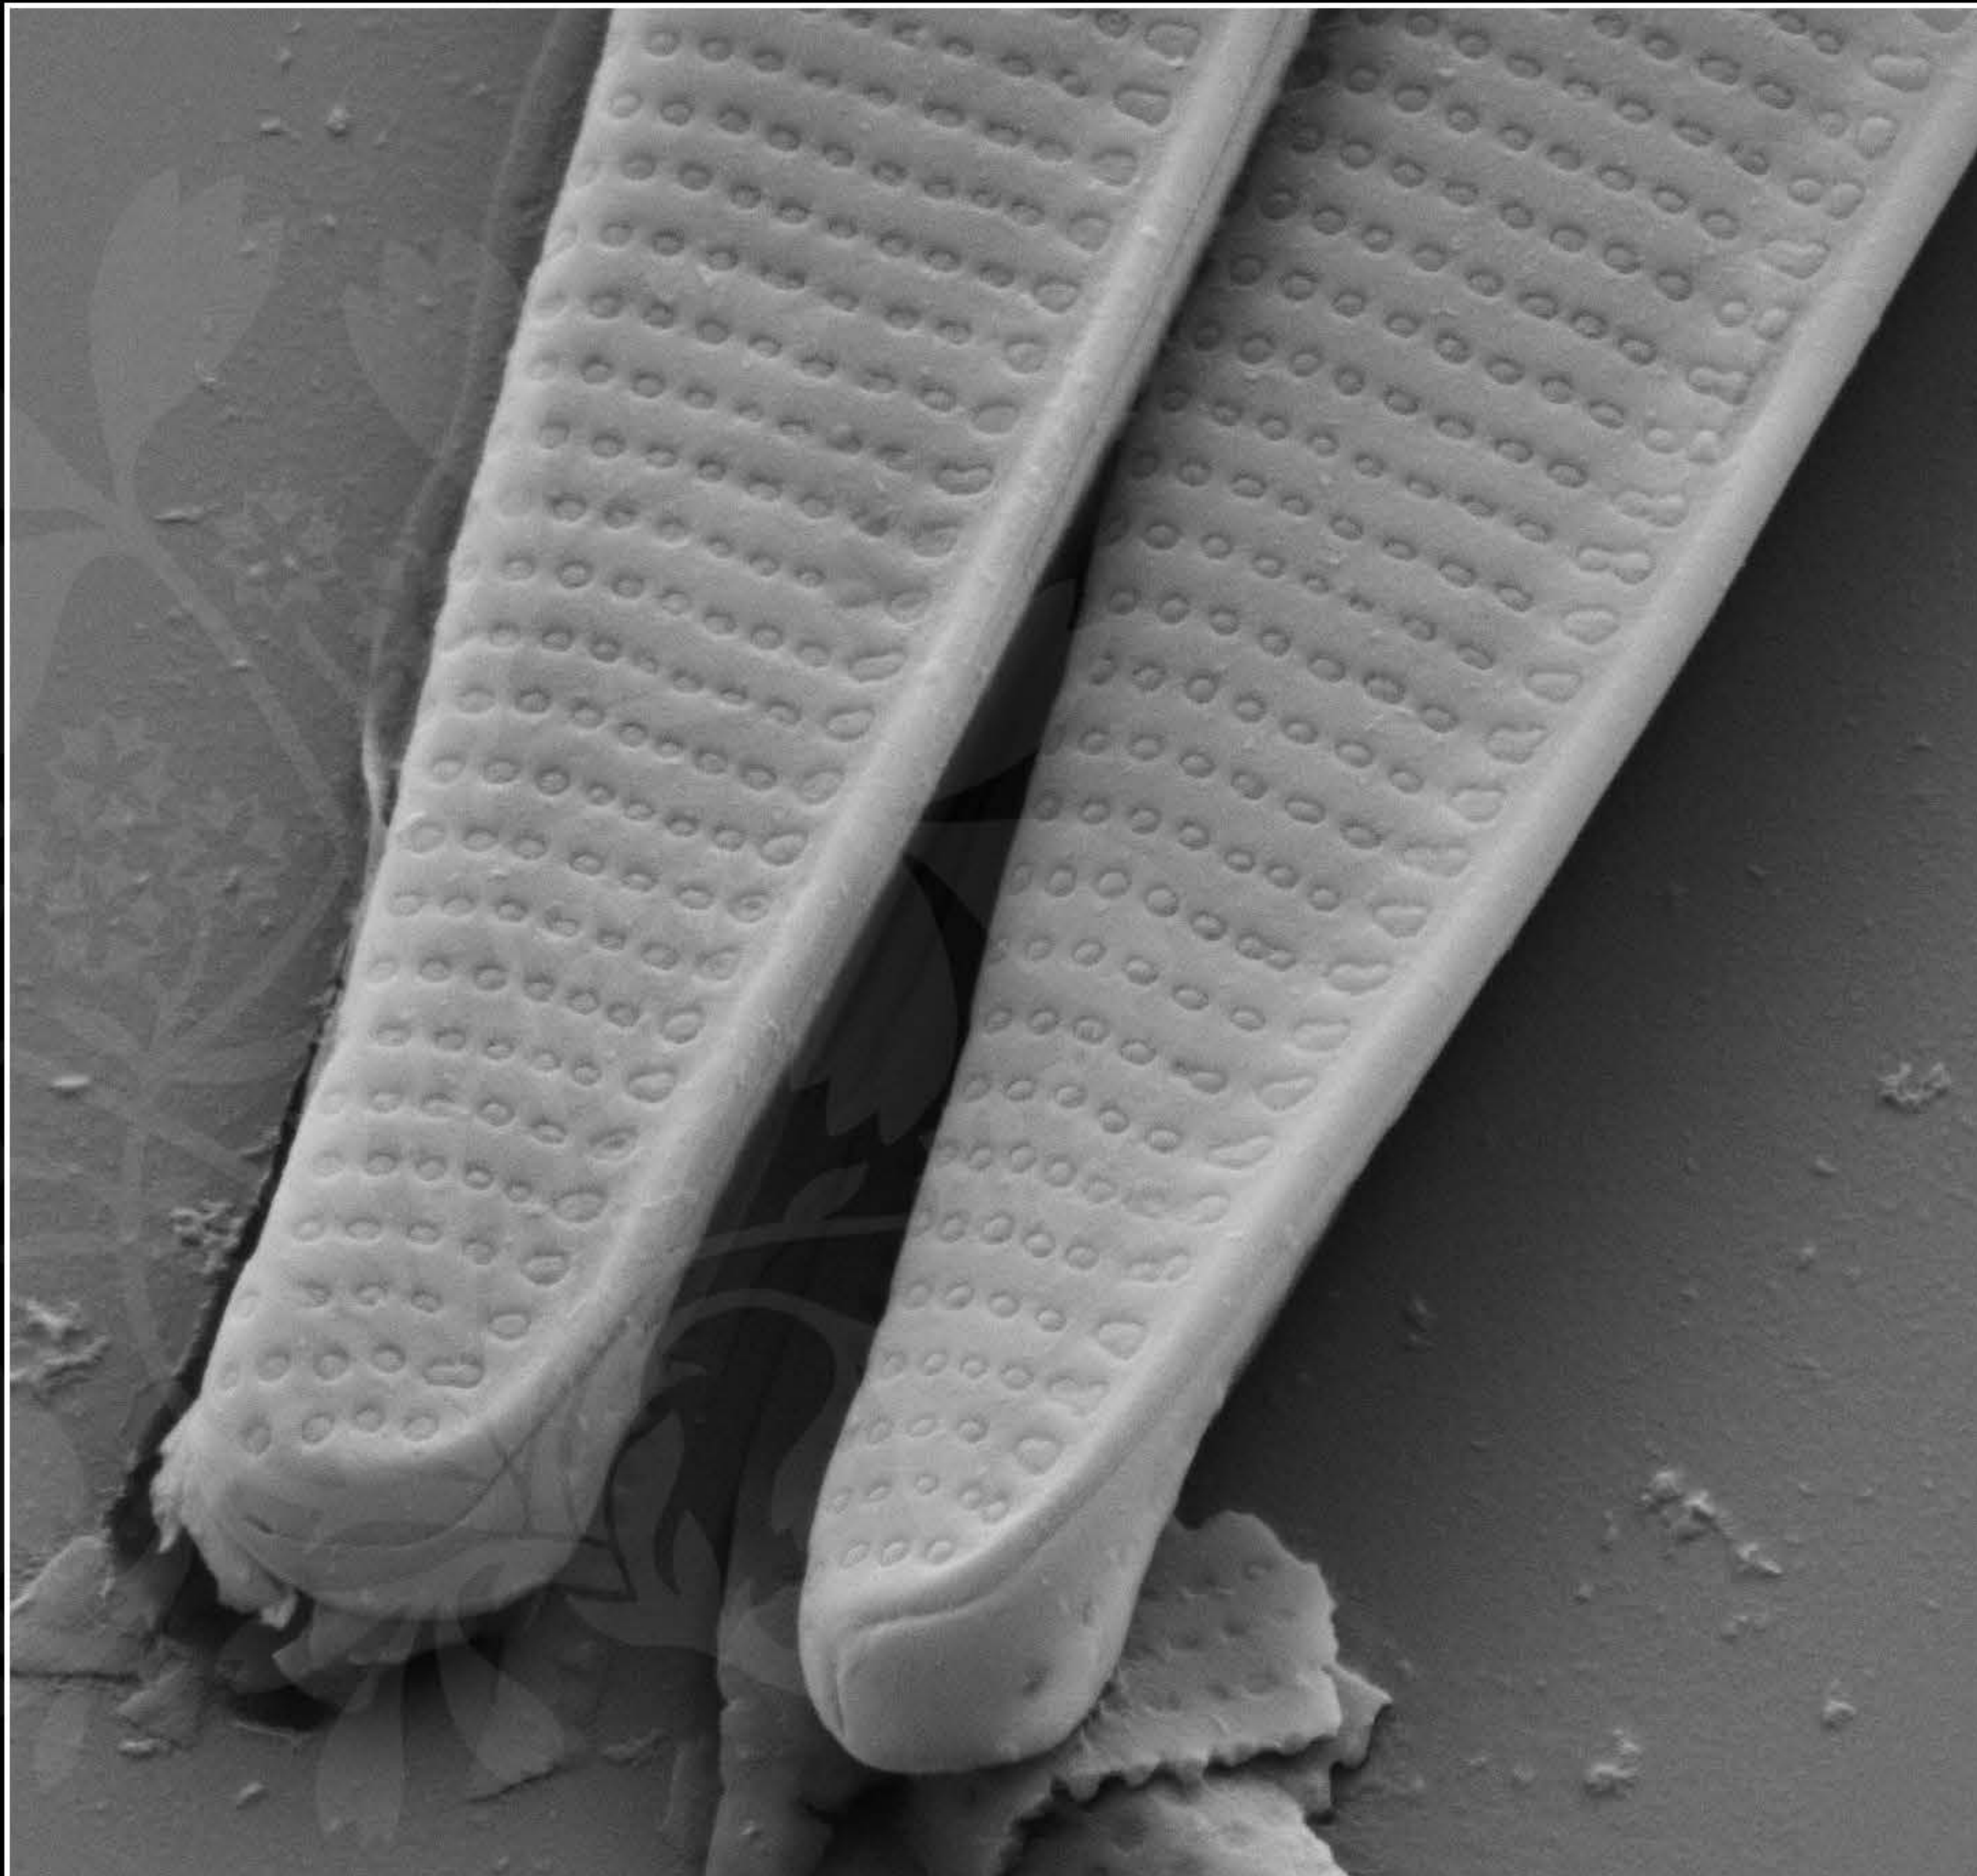

200 nm
└─┘

Mag = 30.00 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_05.tif



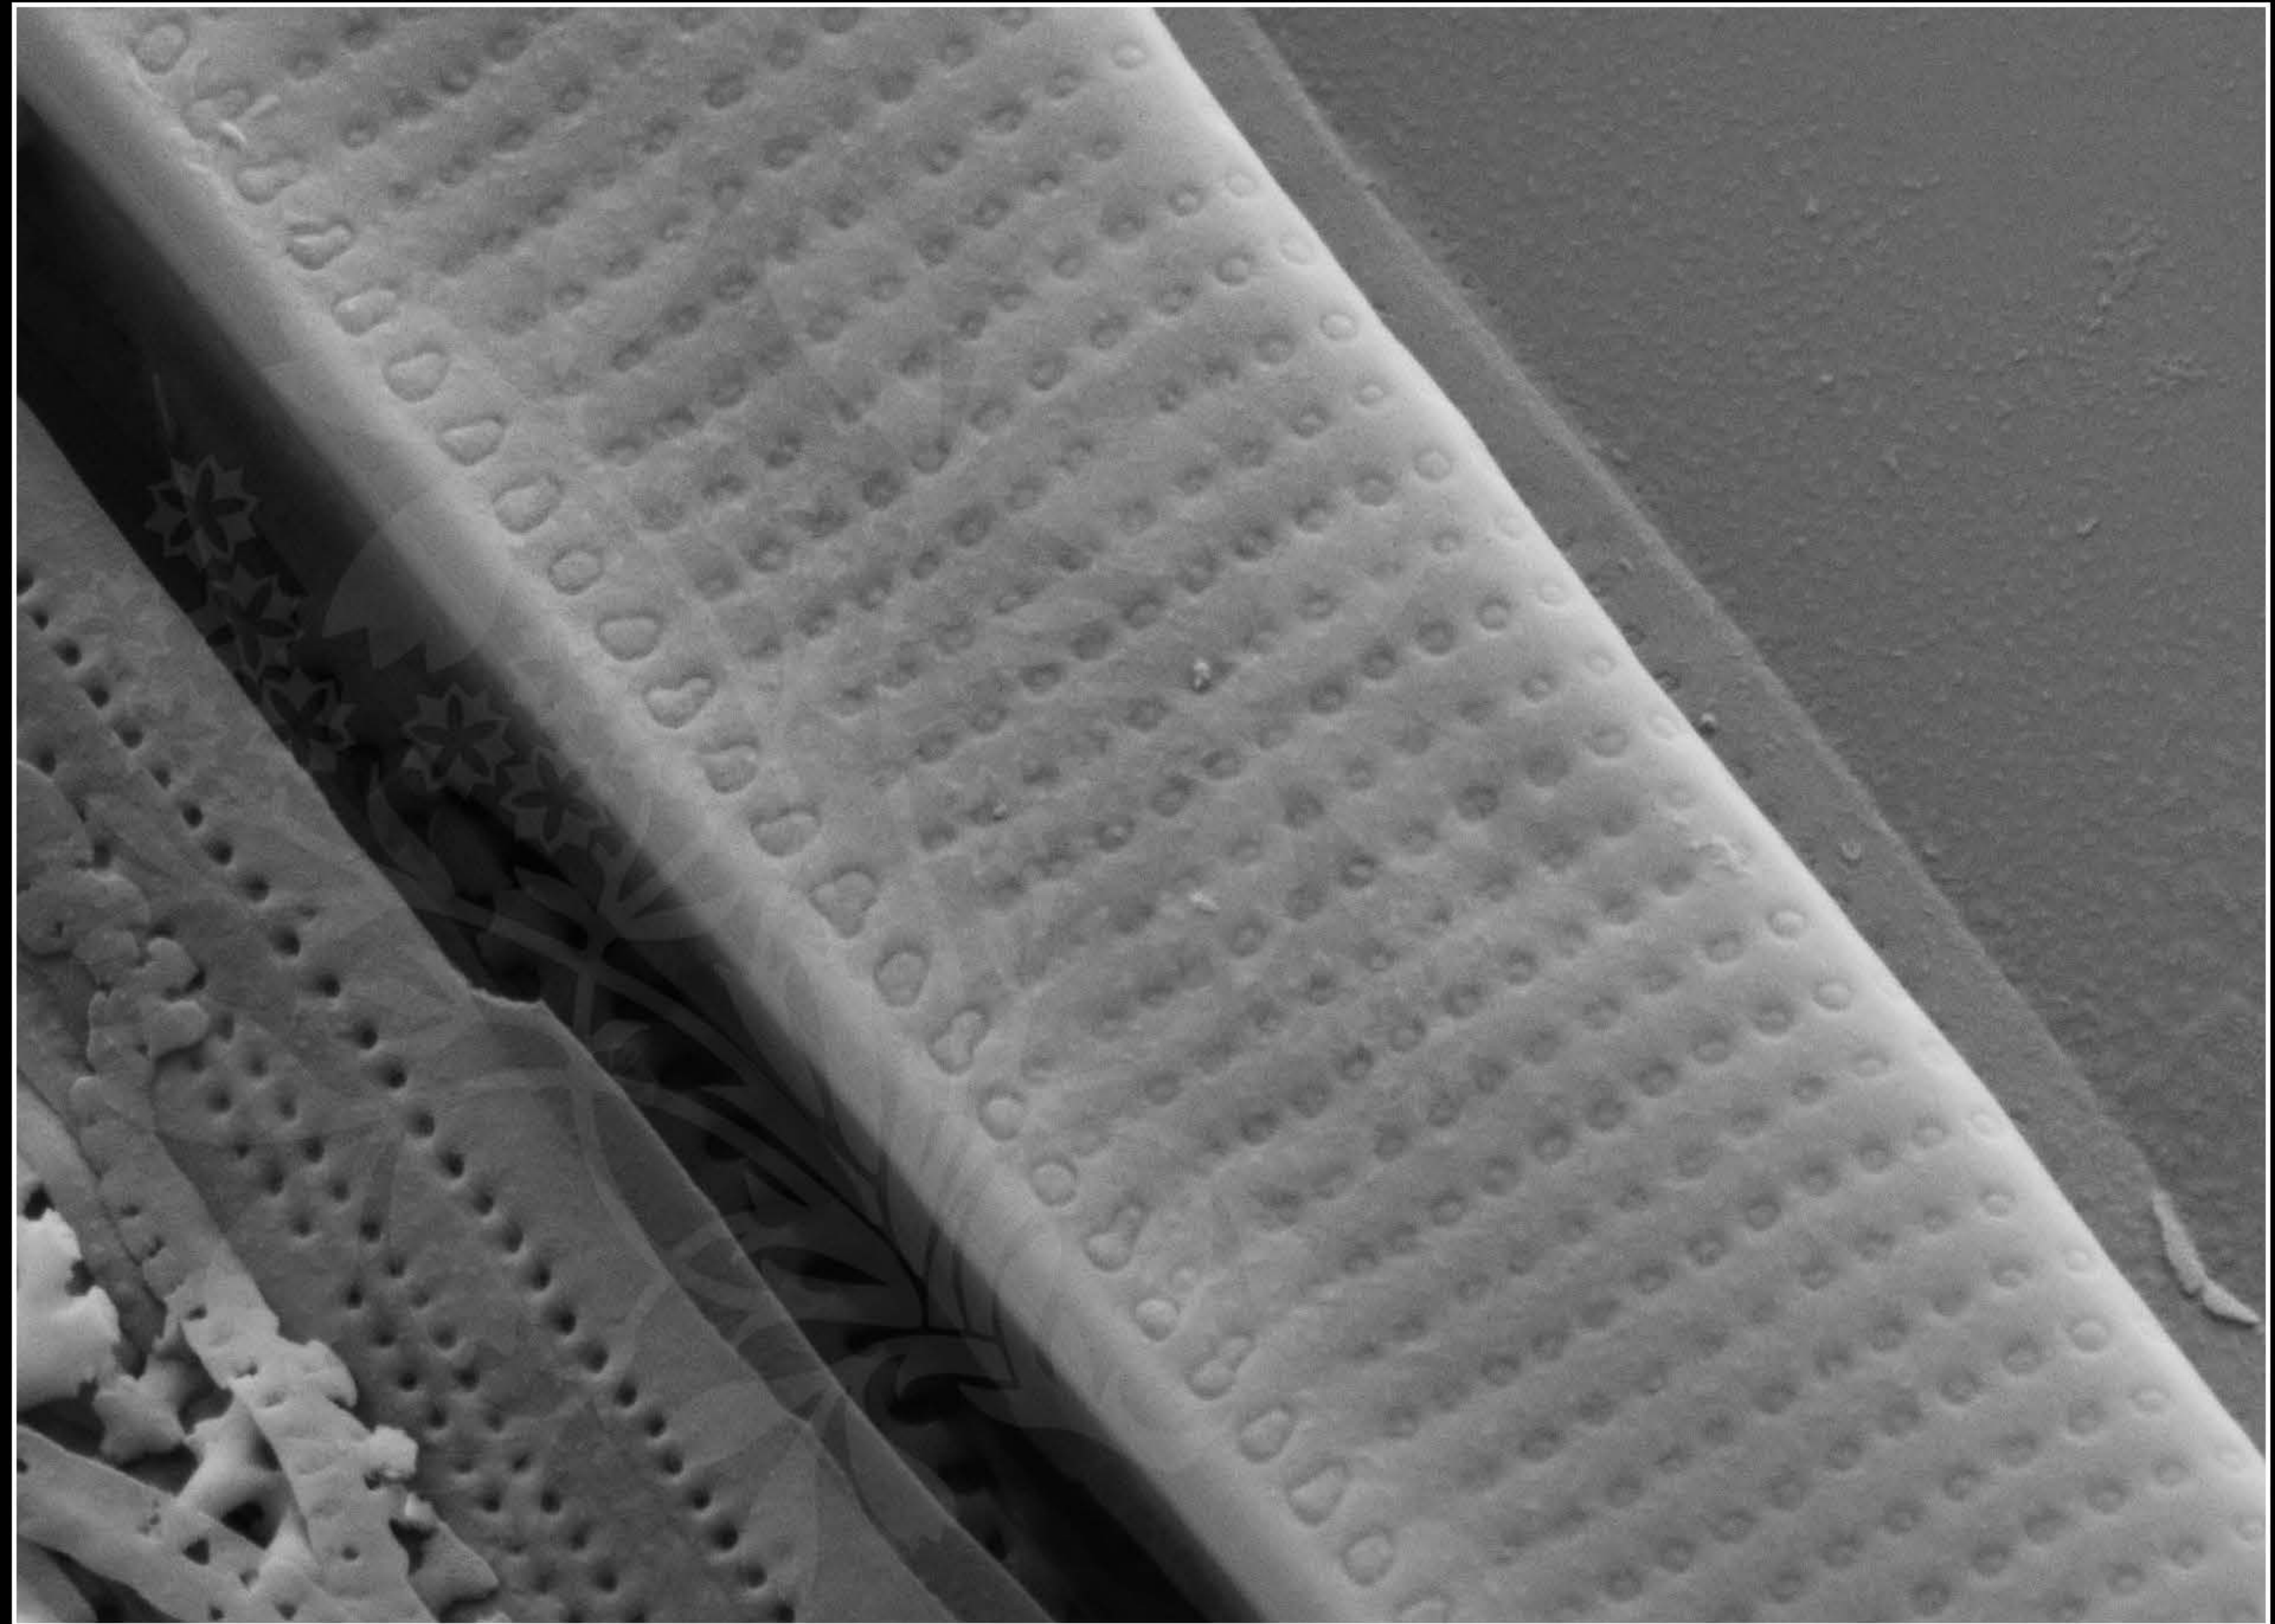

200 nm
└───┘

Mag = 40.00 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_06.tif



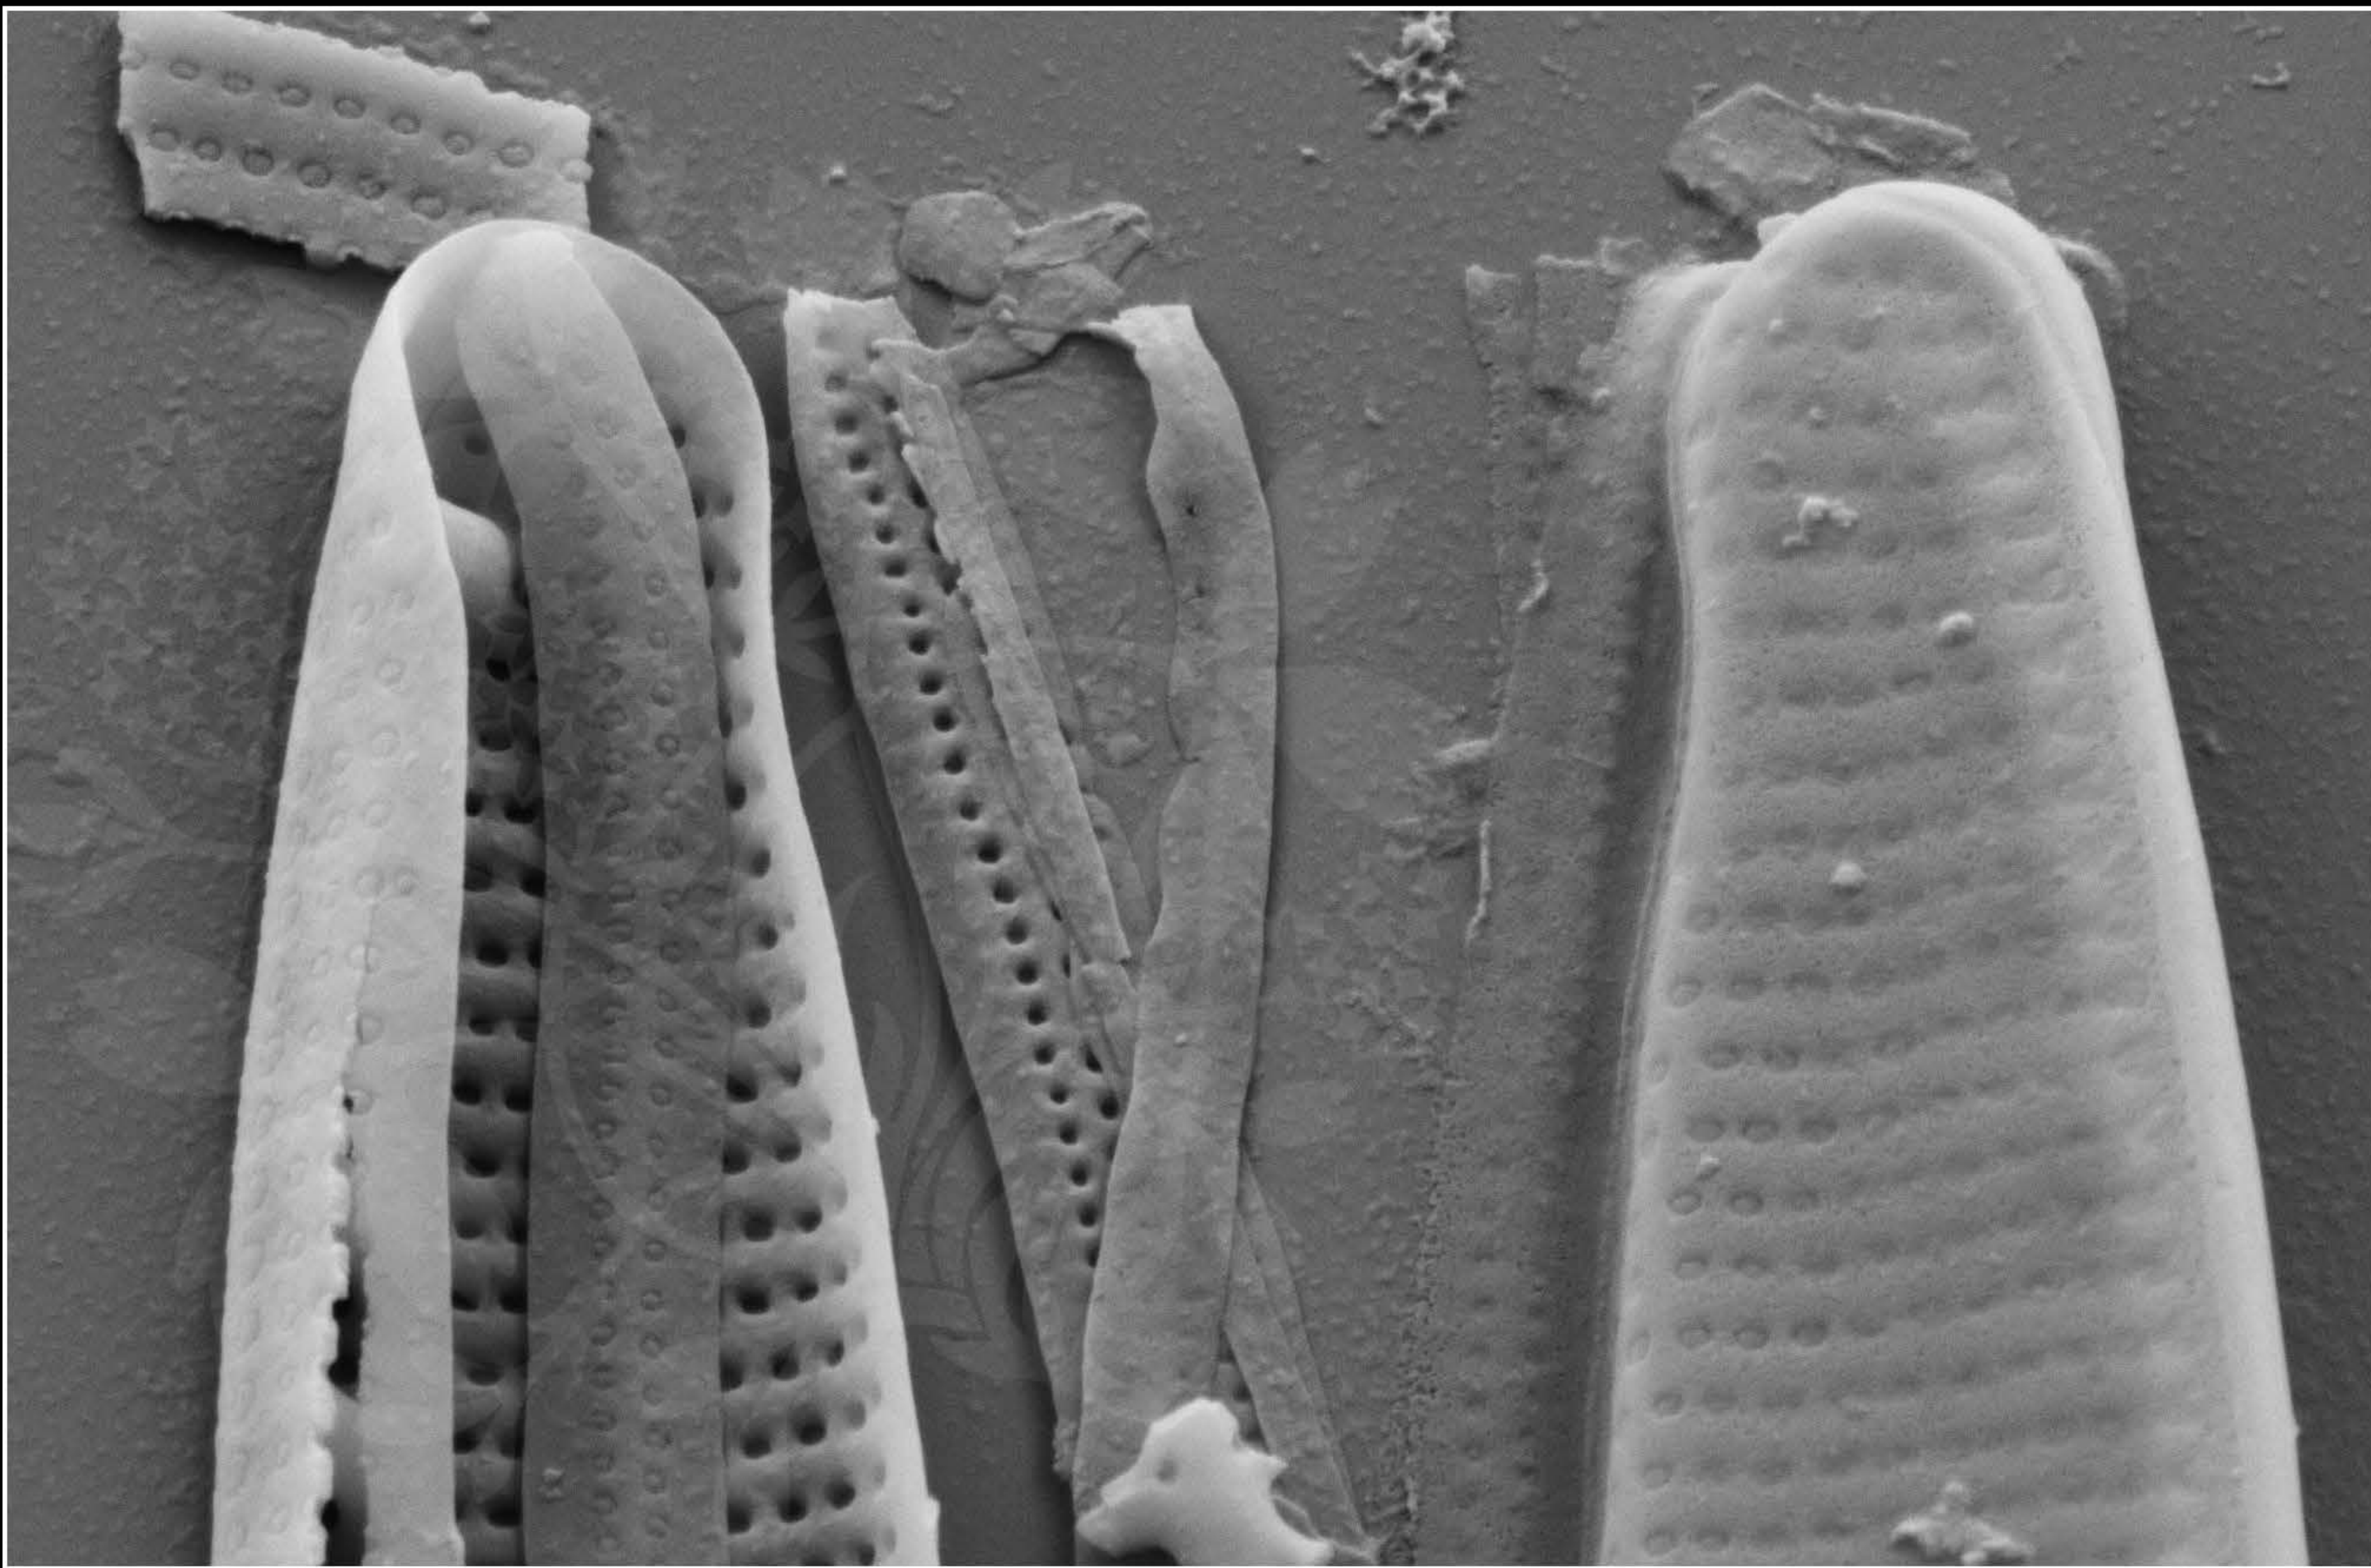

200 nm
└─┘

Mag = 35.00 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_07.tif



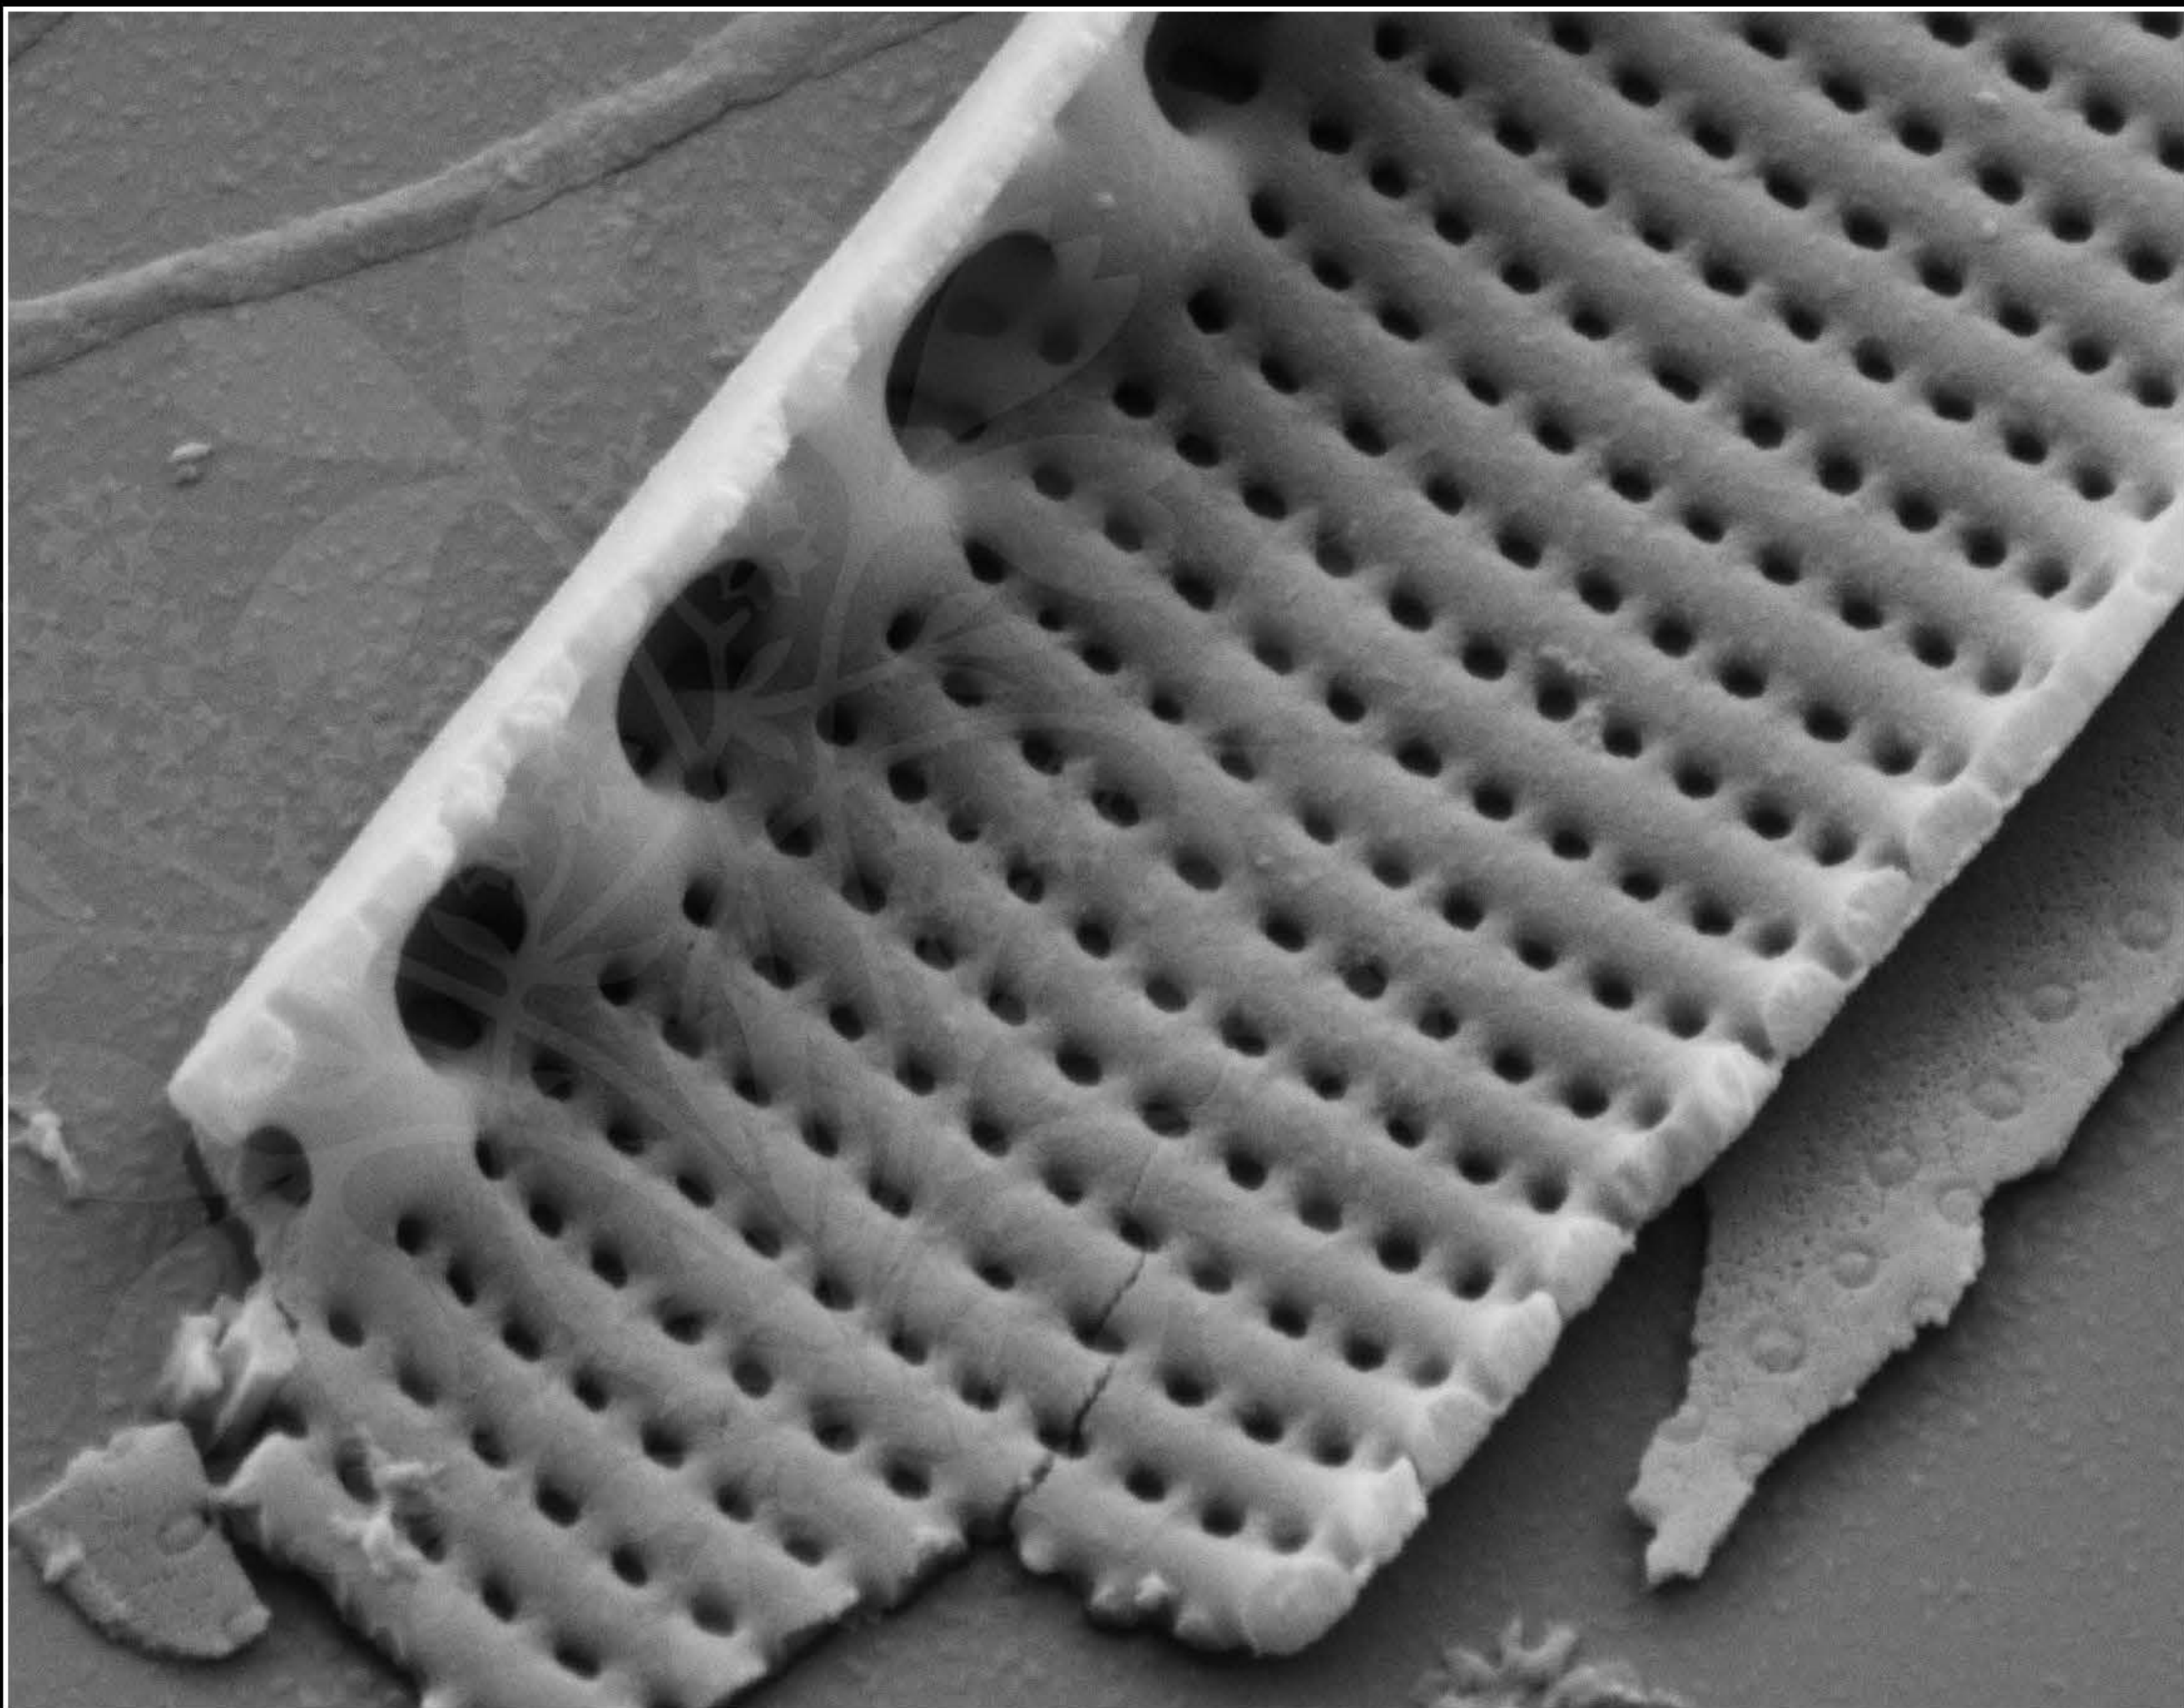

100 nm
┆

Mag = 50.00 K X


EHT = 5.00 kV

Signal A = SE2 Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_08.tif



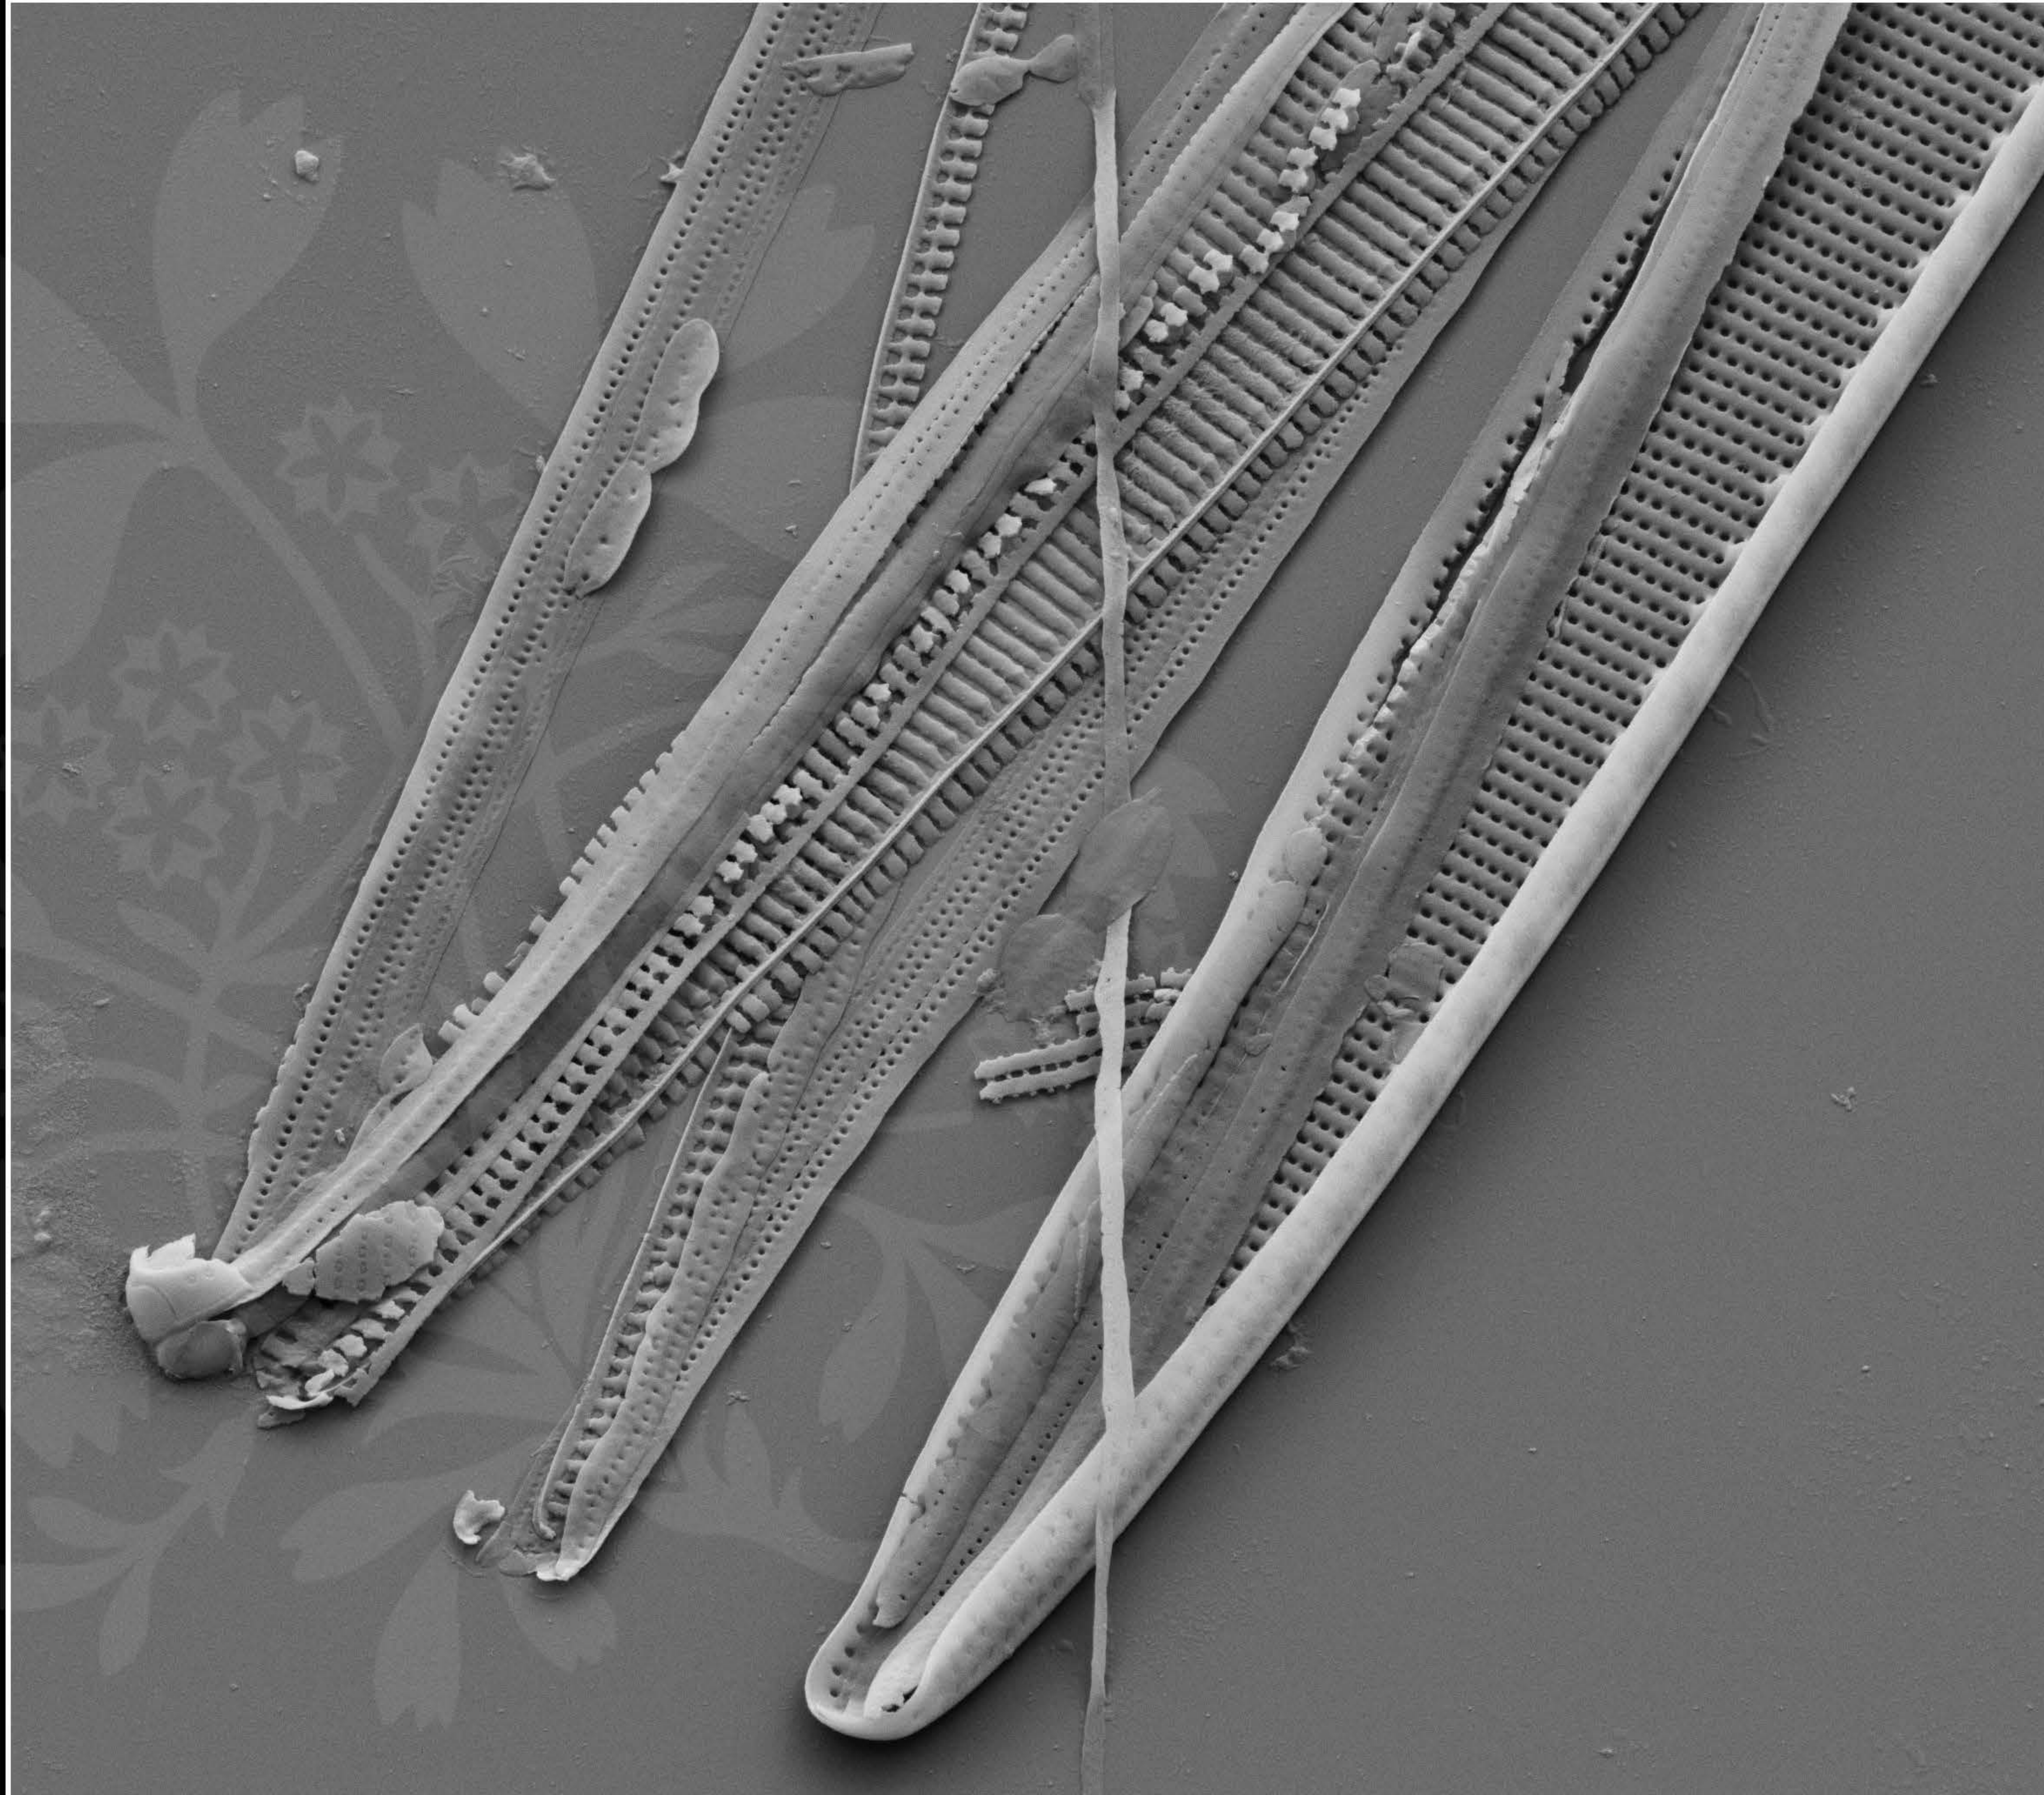

1 μm

Mag = 10.00 K X

EHT = 5.00 kV

Signal A = SE2

Date :16 Jun 2017

WD = 4.3 mm

File Name = Barcode0822_09.tif

